



11EER J42HC-J60HC Series WALL-MOUNT™

The Solair Wall-Mount Heat Pump is a self contained energy efficient heating and cooling system, which is designed to offer maximum indoor comfort at a minimal cost without using valuable indoor floor space or outside ground space. This unit is the ideal product for versatile applications such as: new construction, modular offices, school modernization, telecommunication structures, portable structures or correctional facilities. Factory or field installed accessories are available to meet specific job requirements.

- Complies with efficiency requirements of ASHRAE/IESNA 90.1-2016
- Certified to ASNI/ARI Standard 390-2003 for SPVU (Single Package Vertical Units)
- Intertek ETL Listed to Standard for Safety Heating and Cooling Equipment ANSI/UL 1995/CSA 22.2 No. 236-05 Fourth Edition
- Commercial Product - Not intended for residential application
- Solair is an ISO 9001:2015 Certified Manufacturer



///// WALL-MOUNT NOMENCLATURE

J 6 0 H C A 0 0 X P X X X X

UNIT SERIES
Wall-Mount

NOMINAL CAPACITY
42- 3.5 Ton
48 - 4 Ton
60 - 5 Ton

FUNCTIONALITY
H = Heat Pump

REVISION
C Revision Level

VOLTAGE
A - 230 Volt 1 Phase 60 Hz
B - 230 Volt 3 Phase 60 Hz
C - 460 Volt 3 Phase 60 Hz

ELECTRIC HEAT

VENT PACKAGE
X - Fresh Air Damper
Z - Full Flow Economizer, JADE with Enthalpy
Y - Full Flow Economizer, JADE dry bulb

FILTER
P - 2" MERV8 Disposable Filter

COLOR AND CABINET FINISH
X - Beige baked enamel finish

PLACEHOLDER
"X"for future use

COIL & COATING OPTIONS
X - Standard

ACCESSORIES AND CONTROLS OPTIONS
E - Standard controls, LAC

ENGINEERED FEATURES

NEW! EXCLUSIVE *Non-Fiberglass Foil Faced Insulation: Environmentally friendly high “R” value non-fiberglass insulation that is made with recycled denim and cotton materials used with a FSK foil face that is both durable and cleanable.

Durable Cabinet Construction: Multiple cabinet construction options are available for different outdoor conditions. Optional cabinet coatings may be ordered for extreme outdoor environments. Front access control panel location.

Green Fin Hydrophilic Evaporator Coil: Green fin stock is used to help prevent mold growth, aid with condensate drainage, and provide a limited amount of protection to corrosive particulates in the airstream.

***Balanced Climate™ Technology (patent pending):** High latent capacity humidity & sound reduction removes up to 35% more humidity than any other on the market with the use of a 2 stage thermostat or controlling device. Solair Balanced Climate™ innovation comes standard on all models.

Field or Factory Installed Vents: Multiple ventilation options are available as easily installed kits with electrical plugs, or Factory installed options that can be removed for service. Economizer operation includes improved airpath for minimized recirculation.

Reliable, Easy-to-Use Controls: Easily accessible through front control panel locations. A lockable hinged access cover to circuit protection is provided. Phase rotation monitor is standard on all 3 phase models. Adjustable compressor on/off delay timer (CCM) with diagnostic lights is standard on all models.

ECM Indoor Brushless DC Motor Technology: 5 speed dual shaft motor provides quiet airflow operation when used with a twin blower assembly. Motor overload protection standard on all models.




Electric Strip Heat: Reliable, comfortable heater packages feature an automatic limit and thermal cut-off safety control. Heater packages can be factory or field installed.

Easy Filter Access: A separate filter door is provided for ease of filter access during routine unit maintenance. 2” filters are available with a rating of up to MERV8.

Enclosed Condenser Motor: An enclosed casing condenser motor with ball bearings is used for reliable operation and extended motor life. Enclosed condenser motors are standard on all units.

Improved Condenser Coil Cleaning: Removable fan shroud side panels allow for easy condenser coil intake surface cleaning.

High Efficiency Cooling: Scroll compressors for quiet, efficient cooling. Designed with R-410A (HFC) non-ozone depleting refrigerant in compliance with the Montreal protocol and 2010 EPA requirements. A liquid line filter-drier to protect the system from moisture is standard on all units.

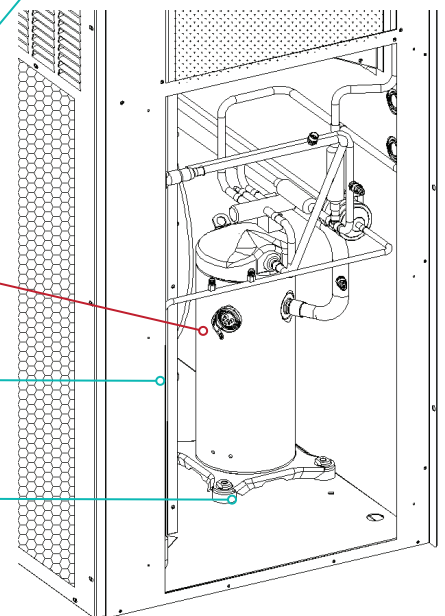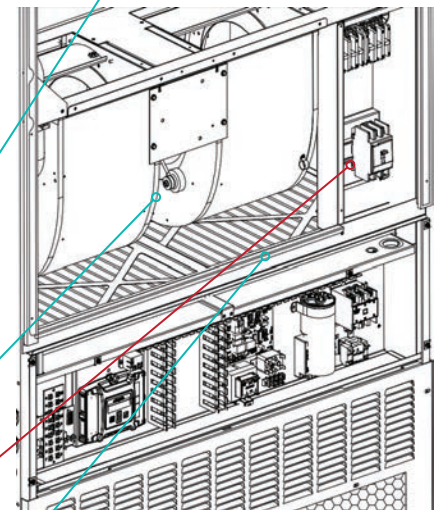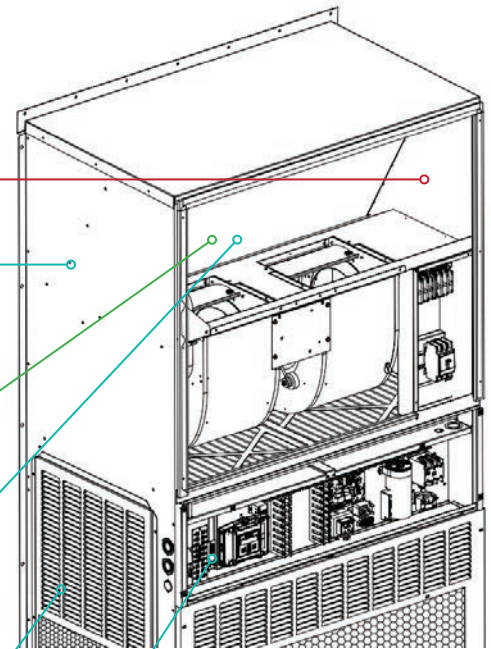

UNIT MODES OF OPERATION

Cooling Operation: The Solair J**HC Series WALL MOUNT products offer single stage cooling operation using R410A refrigerant. Copper tube/Aluminum fin coils are used to provide high efficiency and easy serviceability. Scroll compressor technology delivers years of quiet, reliable operation.



Heating Operation: The Solair JH Series WALL MOUNT products offer single stage heat pump operation and optional single or two stage heating operation using resistance heaters. Circuit breaker disconnect protection is standard in all units equipped with electric heat.



Ventilation Operation: The Solair JH Series WALL MOUNT products offer optional ventilation that brings outdoor air into the structure. Vent options can be factory or field installed, and can be used to bring in outdoor air for occupants, save energy by using outdoor air for free cooling, or positively pressurize a structure. Exhaust air options allow room air to be vented outdoors when fresh air is being brought into the structure. Energy recovery options are also available for occupied structures which condition the air being brought in to save energy when ventilation is necessary regardless of outdoor temperature.



Balanced Climate™ Operation: The Solair JH Series WALL MOUNT products offer an enhanced latent capacity stage that can be controlled by a two stage cooling thermostat. During the first cooling stage (Balanced Climate Mode), the unit will increase the amount of moisture removed during compressor operation. The second stage (standard mode) of cooling increases the sensible cooling capacity to increase the amount of heat removed from the structure during compressor operation. available in high supply static applications. In order for Balanced Climate to be used, a jumper must be removed between Y1 and Y2. Unit is shipped with jumper in place and Balanced Climate disabled.



ADVANCED FEATURE DESCRIPTIONS

ECM Indoor Blower Motor: Energy efficient indoor blower motors use EC constant torque technology with 5 pre-programmed speeds. By selecting the needed speed, the WALL MOUNT product can reduce or increase airflow. A NEMA48@ frame enclosure is used. A medium and high speed tap can be user selected to offer the maximum CFM possible with the blower assembly.

- Efficient 5 speed ECM constant torque motor. 24VAC power used for speed selection.
- Fully potted electronic control module for moisture protection.
- 6000V surge protection.
- Dual shaft design with open air over (OAO) enclosure.



Outdoor Fan Motor: Outdoor fan motors use ball bearing construction and are fully enclosed for increased life expectancy.

- Single speed PSC motor.
- Totally enclosed motor housing protects motor windings and internal components from corrosion.
- Ball bearing design reduces motor wear from “windmill” affect when not in operation.



Non Fiberglass Cabinet Insulation: The JH MOUNT products use advanced non-fiberglass insulation that is made with recycled denim materials. High "R" value, enhanced sound absorption, and reduced delamination are some of the features of this revolutionary product.

- Easy to clean and damage resistant Foil FSK Facing.
- Fiberglass and Formaldehyde free.
- Meets ASTM E84, UL 723, NFPA 90A and 90B Standards.
- Thermal performance ASTM C518 k=.27@1" & 900gsm



CAPACITY AND EFFICIENCY RATINGS

MODELS	J42HC	J48HC	J60HC
Cooling BTUH ①	42,000	47,500	54,500
EER ②	11.0	11.0	11.0
High Temp Heating (47F) BTUH ①	38,204	41,378	50,712
COP ②	3.3	3.3	3.3
Low Temp Heating (17F) BTUH ①	24,752	25,135	33,349
COP ②	2.3	2.1	2.3

① Cooling and Heating Capacities are certified in accordance with ANSI/ARI Standard 390-2003.

② EER = Energy Efficiency Ratio. COP = Coefficient of Performance. Energy efficiency data is certified in accordance with ANSI/ARI Standard 390-2003.

SPECIFICATIONS 3-1/2 TON THROUGH 6 TON

MODELS	J42HC-A	J42HC-B	J42HC-C	J48HC-A	J48HC-B	J48HC-C
Electrical Rating – 60 Hz	230/208 - 1	230/208-3	460 - 3	230/208 - 1	230/208 - 3	460 - 3
Operating Voltage Range	197-253	197-253	414-506	197-253	197-253	414-506
Compressor--Circuit A						
Voltage	230/208	230/208	460	230/208	230/208	460
Rated Load Amps	17.2/19.3	11.8/13.2	6.0	16.0/18.6	10.1/11.7	6.4
Branch Circuit Selection Current	19.9	13.6	6.0	21.8	13.8	6.3
Lock Rotor Amps	109/109	83.1/83.1	41	117/117	83.1/83.1	41
Compressor Type	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll
Fan Motor & Condenser						
Fan Motor--HP--RPM	1/3	1/3	1/3	1/3	1/3	1/3
Fan Motor--Amps	2.3	2.6	0.8	1.6	2.6	1.3
Fan--DIA/CFM	24" - 2900	24" - 2900	24" - 2900	24" - 3000	24" - 3000	
Blower Motor & Evap.						
Blower Motor--HP-SPD	1/3 Variable	1/3 Variable	1/3 Variable	1/3 Variable	1/3 Variable	1/3 Variable
Blower Motor--Amps	2.3	2.3	1.6	3.1	2.3	1.2
Motor Type	Constant Torque ECM	Constant Torque ECM	Constant Torque ECM	Constant Torque ECM	Constant Torque ECM	Constant Torque ECM
CFM Cooling & E.S.P. w/Filter (Rated-Wet Coil)	.15	.15	.15	TBD	TBD	TBD
Filter Sizes (inches) STD., 2 required	20x20x1	20x20x1	20x20x1	20x20x1	20x20x1	20x20x1
Basic Unit Weight-LBS.	500	500	500	505	505	505
Barometric Fresh Air Damper (X)	13	13	13	13	13	13
Economizer (Z)	44	44	44	44	44	44
Economizer (Y)	44	44	44	44	44	44

MODELS	J60HC-A	J60HC-B	J60HC-C
Electrical Rating – 60 Hz	230/208 - 1	230/208 - 3	460 - 3
Operating Voltage Range	197-253	197-253	414-506
Compressor--Circuit A			
Voltage	230/208	230/208	460
Rated Load Amps	26.0/30.1	12.4/14.0	7.8
Branch Circuit Selection Current	26.5	16.0	7.8
Lock Rotor Amps	134/134	110/110	52
Compressor Type	Scroll	Scroll	Scroll
Fan Motor & Condenser			
Fan Motor--HP--RPM	1/3	1/3	1/3
Fan Motor--Amps	1.8	1.8	0.9
Fan--DIA/CFM	24" - 3100	24" - 3100	24" - 3100
Blower Motor & Evap.			
Blower Motor--HP-SPD	3/4 Variable	1/2 Variable	1/2 Variable
Blower Motor--Amps	3.2	3.2	1.6
Motor Type	Constant Torque ECM	Constant Torque ECM	Constant Torque ECM
CFM Cooling & E.S.P. w/Filter (Rated-Wet Coil)	TBD	TBD	TBD
Filter Sizes (inches) STD., 2 required	20x20x1	20x20x1	20x20x1
Basic Unit Weight-LBS.	515	515	515
Barometric Fresh Air Damper (X)	13	13	13
Economizer (Z)	44	44	44
Economizer (Y)	44	44	44

OPTIONAL SHIPPING CRATES

Optional crates are available to help protect your valuable WALL MOUNT investment during shipping. Constructed from OSB sheathing with steel corner posts, and sized for standard truck transportation. Treated for pests in accordance with the International Plant Protection Convention, Publication 15, Annex 1. Packaging is acceptable for international shipments.

CRATE NO.	UNITS USING CRATE	DESCRIPTION
TBD	J42HC, J48HC	Standard Unit Crate
TBD	J60HC	Standard Unit Crate

COOLING APPLICATION DATA - OUTDOOR TEMPERATURE ①②

MODEL	RETURN AIR (DB/WB)	COOLING CAPACITY	75°F	80°F	85°F	90°F	95°F	100°F	105°F	110°F	115°F	120°F	125°F
J42HC	75/62	Total Cooling	44600	42500	40500	38500	36600	34800	33100	31300	29700	28000	26400
		Sensible Cooling	35300	34000	32900	31800	30800	30000	29100	28400	27600	27100	26400
	80/67	Total Cooling	47600	46300	44900	43500	42000	40500	39000	37300	35700	33900	32100
		Sensible Cooling	34200	33300	32600	31800	31100	30500	29800	29300	28700	28300	27800
	85/72	Total Cooling	56700	54100	51600	49100	46700	44300	42100	39700	37500	35200	33000
		Sensible Cooling	35000	33800	32800	31600	30500	29500	28400	27500	26500	25600	24600
J48HC	75/62	Total Cooling	54100	50500	47200	44200	41400	38800	36500	34300	32300	30500	28800
		Sensible Cooling	41600	40000	38500	37100	35800	34600	33500	32600	31700	30500	28800
	80/67	Total Cooling	57700	55000	52400	49900	47500	45200	43000	40900	38900	36900	35100
		Sensible Cooling	40300	39200	38100	37100	36100	35200	34400	33700	33000	32400	31800
	85/72	Total Cooling	68700	64300	60200	56300	52800	49500	46400	43500	40900	38400	36100
		Sensible Cooling	41300	39800	38300	36900	35400	34100	32800	31600	30400	29300	28200
J60HC	75/62	Total Cooling	58100	55300	52600	50000	47500	45200	42800	40600	38500	36400	34400
		Sensible Cooling	45700	44500	43300	42100	41000	40000	39000	37900	37000	36100	34400
	80/67	Total Cooling	62000	60200	58400	56500	54500	52600	50500	48400	46300	44100	41900
		Sensible Cooling	44300	43600	42900	42100	41400	40700	40000	39200	38500	37800	37000
	85/72	Total Cooling	73900	70400	67100	63800	60500	57500	54500	51500	48700	45800	43100
		Sensible Cooling	45400	44300	43100	41800	40600	39400	38100	36800	35500	34200	32700

- ① Low ambient control allows for compressor operation down to 0°F.
- ② Outdoor temperatures shown are measured at the condenser section air inlet.
- ③ Return air temperature °F.

CAPACITY MULTIPLIER FACTORS			
% of Rated Airflow	-10	Rated	+10
Total BTUH	0.975	1.0	1.02
Sensible BTUH	0.950	1.0	1.05

HEATING APPLICATION RATING AND OUTDOOR TEMPERATURE °F ①②

MODEL		0°F	5°F	10°F	15°F	17°F	20°F	25°F	30°F	35°F	40°F	45°F	47°F	50°F	55°F	60°F	65°F
J42HC	BTUH	19182	20666	22278	24019	24752	25889	27887	30013	32268	34651	37163	38204	39804	42573	45470	48496
	WATTS	3063	3071	3084	3103	3112	3127	3156	3191	3232	3278	3329	3351	3386	3448	3516	3589
	COP	1.835	1.972	2.117	2.269	2.331	2.427	2.590	2.756	2.926	3.098	3.272	3.300	3.446	3.619	3.791	3.960
J48HC	BTUH	18724	20400	22250	24276	25135	26476	28851	31401	34126	37025	40099	41378	43348	46772	50370	54143
	WATTS	3334	3357	3385	3418	3432	3455	3498	3545	3597	3654	3715	3741	3782	3853	3929	4009
	COP	1.646	1.781	1.927	2.082	2.146	2.246	2.417	2.596	2.781	2.970	3.163	3.300	3.359	3.558	3.758	3.958
J60HC	BTUH	26039	27999	30117	32394	33349	34829	37422	40173	43083	46151	49377	50712	52762	56305	60006	63865
	WATTS	4003	4060	4118	4177	4200	4236	4296	4357	4418	4480	4542	4567	4605	4669	4733	4798
	COP	1.907	2.021	2.143	2.273	2.327	2.410	2.553	2.702	2.858	3.019	3.186	3.300	3.358	3.535	3.716	3.901

Performance given for 70°F DB indoor return air at rated CFM. Data includes defrost operation below 45° outdoor temperature.

- ① Supplemental Electric heaters are recommended for applications requiring heating below a 15°F outdoor temperature.
- ② Outdoor temperatures shown are measured at the condenser section air inlet.

///// R410A UNIT CHARGE RATES

UNIT	STD. UNIT - LBS.
J42HC	7.625
J48HC	9.750
J60HC	10.750

///// BALANCED CLIMATE APPLICATION DATA (OPTIONAL, REQUIRES 2 STAGE COOLING THERMOSTAT)

MODEL	RETURN AIR (DB/AB)	COOLING CAPACITY	75°F	80°F	85°F	90°F	95°F	100°F	105°F	110°F	115°F	120°F	125°F
J42HC	75/62	Total Cooling	43100	41100	39300	37400	35500	33800	32000	30300	28600	26800	25100
		Sensible Cooling	30200	29300	28400	27500	26600	25800	24900	24100	23300	22500	21700
		Latent Cooling	12900	11800	10900	9900	8900	8000	7100	6200	5300	4300	3400
		% Latent Increase	28%	28%	30%	32%	35%	40%	44%	53%	60%	79%	100%
		Lbs. H2O per Hr.	12.17	11.13	10.28	9.34	8.396	7.547	6.698	5.849	5	4.057	3.208
	80/67	Total Cooling	46000	44800	43600	42200	40765	39300	37700	36100	34400	32500	30600
		Sensible Cooling	29300	28700	28100	27500	26800	26200	25500	24900	24200	23500	22800
		Latent Cooling	16700	16100	15500	14700	13965	13100	12200	11200	10200	9000	7800
		% Latent Increase	20%	19%	21%	20%	22%	24%	25%	29%	31%	38%	45%
85/72	Total Cooling	54800	52400	50100	47700	45300	43000	40700	38400	36200	33800	31500	
	Sensible Cooling	30000	29200	28300	27300	26300	25400	24300	23400	22300	21300	20200	
	Latent Cooling	24800	23200	21800	20400	19000	17600	16400	15000	13900	12500	11300	
	% Latent Increase	13%	13%	14%	14%	15%	16%	16%	19%	21%	23%	26%	
J48HC	75/62	Total Cooling	48800	46300	43800	41300	39000	36800	34700	32500	30500	28500	26500
		Sensible Cooling	34200	33100	32100	31000	30000	29000	28000	26900	25900	24900	23800
		Latent Cooling	14600	13200	11700	10300	9000	7800	6700	5600	4600	3600	2700
		% Latent Increase	14%	20%	26%	31%	38%	46%	55%	70%	87%	100%	100%
		Lbs. H2O per Hr.	13.77	12.45	11.04	9.717	8.491	7.358	6.321	5.283	4.34	3.396	2.547
	80/67	Total Cooling	52100	50400	48600	46700	44798	42900	40900	38800	36700	34500	32300
		Sensible Cooling	33100	32400	31800	31000	30300	29500	28700	27800	26900	26000	25000
		Latent Cooling	19000	18000	16800	15700	14498	13400	12200	11000	9800	8500	7300
		% Latent Increase	8%	12%	15%	18%	21%	25%	30%	35%	40%	47%	55%
85/72	Total Cooling	62100	58900	55800	52700	49800	46900	44100	41300	38600	35900	33200	
	Sensible Cooling	33900	32900	32000	30800	29700	28600	27400	26100	24800	23500	22100	
	Latent Cooling	28200	26000	23800	21900	20100	18300	16700	15200	13800	12400	11100	
	% Latent Increase	3%	6%	8%	11%	13%	16%	19%	22%	24%	27%	29%	
J60HC	75/62	Total Cooling	54800	52400	50100	47800	45400	43200	40900	38700	36600	34300	32200
		Sensible Cooling	38800	37800	36900	35800	34800	33800	32800	31800	30700	29600	28500
		Latent Cooling	16000	14600	13200	12000	10600	9400	8100	6900	5900	4700	3700
		% Latent Increase	23%	26%	30%	34%	39%	45%	53%	61%	75%	94%	100%
		Lbs. H2O per Hr.	15.09	13.77	12.45	11.32	10	8.868	7.642	6.509	5.566	4.434	3.491
	80/67	Total Cooling	58500	57100	55600	54000	52147	50300	48300	46200	44000	41600	39200
		Sensible Cooling	37600	37000	36500	35800	35100	34400	33600	32800	31900	31000	30000
		Latent Cooling	20900	20100	19100	18200	17047	15900	14700	13400	12100	10600	9200
		% Latent Increase	15%	17%	19%	21%	23%	25%	29%	31%	36%	41%	47%
85/72	Total Cooling	69700	66800	63900	61000	57900	55000	52100	49200	46200	43200	40300	
	Sensible Cooling	38500	37600	36700	35600	34400	33300	32000	30800	29400	28000	26600	
	Latent Cooling	31200	29200	27200	25400	23500	21700	20100	18400	16800	15200	13700	
	% Latent Increase	9%	11%	12%	13%	15%	17%	18%	20%	21%	24%	24%	
		Lbs. H2O per Hr.	29.43	27.55	25.66	23.96	22.17	20.47	18.96	17.36	15.85	14.34	12.92

- ① Low ambient operation disables Balanced Climate Operation.
- ② Outdoor temperatures shown are measured at the condenser section air inlet.
- ③ Return air temperature °F.
- ④ % Latent increase is a comparison to non-Balanced Climate unit operation.

CAPACITY MULTIPLIER FACTORS			
% of Rated Airflow	-10	Rated	+10
Total BTUH	0.975	1.0	1.02
Sensible BTUH	0.950	1.0	1.05

INDOOR AIRFLOW CFM @ STATIC PRESSURES - EC BLOWER CONSTANT TORQUE MOTOR WITH ADJUSTMENT SPEEDS

ESP	J42HC BLOWER TAPS - DRY/WET COIL CFM					J48HC BLOWER TAPS - DRY/WET COIL CFM				
In H2O	Blower and Vent Only	Balanced Climate	Default LO Cooling and Heating	Optional MED Cooling and Heating	Optional HI Cooling and Heating	Blower and Vent Only	Balanced Climate	Default LO Cooling and Heating	Optional MED Cooling and Heating	Optional HI Cooling and Heating
0"	1575/1460	1205/1065	1575/1460	1745/1640	1815/1690	1745/1665	1320/1270	1745/1665	1895/1800	1985/1860
.1"	1485/1400	1050/955	1485/1400	1665/1560	1740/1630	1700/1615	1225/1160	1700/1615	1850/1760	1915/1810
.15"	1440/1360	980/900	1440/1360	1625/1520	1705/1600	1675/1585	1180/1110	1675/1585	1825/1735	1880/1780
.2"	1400/1325	915/845	1400/1325	1585/1485	1665/1570	1650/1555	1130/1060	1650/1555	1795/1705	1845/1755
.3"	1315/1235	Not Used	1315/1235	1510/1415	1590/1500	1580/1480	Not Used	1580/1480	1735/1640	1780/1690
.4"	1240/1140	Not Used	1240/1140	1435/1345	1515/1430	1500/1400	Not Used	1500/1400	1665/1565	1715/1620
.5"	1165/1030	Not Used	1165/1030	1360/1275	1435/1355	1410/1305	Not Used	1410/1305	1595/1480	1655/1545

ESP	J60HC BLOWER TAPS - DRY/WET COIL CF				
In H2O	Blower and Vent Only	Balanced Climate	Default LO Cooling and Heating	Optional MED Cooling and Heating	Optional HI Cooling and Heating
0"	1985/1890	1485/1490	1985/1890	2075/2005	2165/2030
.1"	1920/1830	1430/1365	1920/1830	2015/1950	2085/1985
.15"	1890/1800	1400/1305	1890/1800	1985/1920	2050/1960
.2"	1855/1765	1360/1250	1855/1765	1955/1885	2015/1935
.3"	1785/1690	Not Used	1785/1690	1890/1820	1955/1880
.4"	1715/1605	Not Used	1715/1605	1825/1750	1900/1820
.5"	1645/1515	Not Used	1645/1515	1755/1675	1855/1750

Five factory programmed speed taps (torque settings) are available for the indoor blower motor, and are selected through different unit modes of operation. These modes are energized by 24VAC signals from the low voltage terminal block located inside the control panel by a thermostat or other controlling device.

1. Blower and Ventilation Only Speed is the CFM amount for continuous fan and ventilation without a call for cooling.
2. Balanced Climate Speed is the indoor CFM amount for user selectable Balanced Climate operation and optional Mechanical Dehumidification. To use Balanced Climate, remove the jumper between Y1 and Y2 on the low voltage terminal strip. A 2 stage cooling thermostat is then used to control blower airflow stages. Be sure to follow all guidelines provided in the installation manual. A controls kit that includes a low ambient control (LAC) must be used for Balanced Climate Operation if ventilation options are to be used or cooling operation will occur below a 60° outdoor temperature. Balanced Climate can be used for duct free and ducted applications below 0.20"WC ESP total static. Balanced Climate provides increased moisture removal during the cooling cycle, but is not a replacement for optional mechanical dehumidification. Optional mechanical dehumidification provides moisture removal without significantly cooling the space being conditioned. Mechanical dehumidification is highly recommended for applications requiring indoor humidity control for schools, public areas, agricultural, pharmaceutical, and areas with high outdoor humidity and varying indoor heat load.
3. Default LO Cooling and Heating Speed is the indoor CFM amount for cooling operation using the default blower speed tap selection. This speed is labeled as LO on the speed selection terminal strip inside the unit control panel. All units ship with cooling and heating operation at LO cooling and heating speed, and provides the optimal airflow amount for normal use.
4. Optional MED Cooling and Heating Speed is selected manually during unit setup and provides a higher indoor CFM for hi static duct applications and increased airflow. This speed is labeled as MED on the speed selection terminal strip inside the unit control panel.
5. Optional HI Cooling and Heating Speed is selected manually during unit setup and provides the highest allowable indoor CFM amount. Not recommended for standard unit operation. This speed is labeled as HI on the speed selection terminal strip inside the unit control panel.

////// ELECTRICAL SPECIFICATIONS — W**HC SERIES

MODEL	Rated Volts & Phase	No. Field Power Circuits	Single Circuit				Dual Circuit								
			① Minimum Circuit Ampacity	② Maximum External Fuse or Ckt. Brkr.	③ Field Power Wire Size	④ Ground Wire	① Minimum Circuit Ampacity		② Maximum External Fuse or Ckt. Breaker		③ Field Power Wire Size		④ Ground Wire Size		
							Ckt. A	Ckt. B	Ckt. A	Ckt. B	Ckt. A	Ckt. B	Ckt. A	Ckt. B	
J42HC-A00, A0Z A04 A05 A10 ④ A15	230/208-1	1	32	45	8	10									
		1	52	60	6	10									
		1	58	60	6	10									
		1 or 2	84	90	4	8	32	52	45	60	8	6	10	10	
		1 or 2	84	90	4	8	32	52	45	60	8	6	10	10	
J42HC-B00, B0Z B06 B09 ③ B15	230/208-3	1	24	35	8	10									
		1	42	50	8	10									
		1	51	60	6	10									
		1	51	60	6	10									
J42HC-C00, C0Z C06 C09 ③ C15	460-3	1	12	15	14	14									
		1	21	25	10	10									
		1	25	30	10	10									
		1	26	30	10	10									
J48HC-A00, A0Z A04 A05 A10 ④ A15 ④ A20	230/208-1	1	35	50	8	10									
		1	56	60	6	10									
		1 or 2	61	70	6	8	35	26	50	30	8	10	10	10	
		1 or 2	87	90	3	8	35	52	50	60	8	6	10	10	
		1 or 2	87	90	3	8	35	52	50	60	8	6	10	10	
		1 or 2	111	125	2	6	58	52	60	60	6	6	10	10	
J48HC-B00, B0Z B06 B09 ③ B15 ③ B18	230/208-3	1	25	35	8	10									
		1	43	50	8	10									
		1	3	60	6	10									
		1	3	60	6	10									
		2	N/A	N/A	N/A	N/A	52	28	60	30	8	10	10	10	
J48HC-C00, C0Z C09 ③ C15	460-3	1	12	15	14	14									
		1	25	30	10	10									
		1	26	30	10	10									
J60HC-A00, A0Z A05 A10 ④ A15 ④ A20	230/208-1	1	42	60	8	10									
		1 or 2	68	90	4	8	47	26	60	30	8	10	10	10	
		1 or 2	94	100	3	6	47	52	60	60	8	6	10	10	
		1 or 2	94	100	3	6	47	52	60	60	8	6	10	10	
		1 or 2	112	125	2	6	60	52	60	60	6	6	10	10	
J60HC-B00, B0Z B09 ③ B15 ③ B18	230/208-3	1	29	40	8	10									
		1	56	60	6	10									
		1	56	60	6	10									
		2	N/A	N/A	N/A	N/A	35	28	40	30	8	10	10	10	
J60HC-C00, C0Z C09 ③ C15	460-3	1	14	20	12	12									
		1	28	30	8	10									
		1	28	30	8	10									

(1) The “Minimum Circuit Ampacity” values are to be used for sizing the field power conductors. Refer to the National Electrical Code (latest version), Article 310 for power conductor sizing.

CAUTION: When more than one field power circuit is run through one conduit, the conductors must be derated. Pay special attention to note 8 of Table 310 regarding Ampacity Adjustment Factors when more than three (3) conductors are in a raceway.

(2) Maximum size of the time delay fuse or circuit breaker for protection of field wiring conductors.

(3) Maximum KW that can operate with the heat pump on is 9KW. Full heat available during emergency heat mode.

(4) Maximum KW that can operate with the heat pump on is 10KW. Full heat available during emergency heat mode.

(5) Based on 75°C copper wire. All wiring must conform to the National Electrical Code and all local codes.

IMPORTANT: While this electrical data is presented as a guide, it is important to electrically connect properly sized fuses & conductor wires in accordance with the National Electrical Code & all local codes.

////// SOUND DATA - DBA @ 5 FT. AND 10 FT.*

DUCT FREE	INDOOR COOLING OPERATION @ 5 FT.			INDOOR COOLING OPERATION @ 10 FT.			OUTDOOR @ 10 FT.
Unit	Standard Grilles	With WMICF	With WMICF and WAPR-11	Standard Grilles	With WMICF	With WMICF and WAPR-11	Standard Features
J42HC	TBD	TBD	TBD	TBD	TBD	TBD	TBD
J48HC	TBD	TBD	TBD	TBD	TBD	TBD	TBD
J60HC	TBD	TBD	TBD	TBD	TBD	TBD	TBD
DUCTED SUPPLY	INDOOR COOLING OPERATION @ 5 FT.			INDOOR COOLING OPERATION @ 10 FT.			OUTDOOR @ 10 FT.
Unit	Standard Grilles	With WMICF	With WMICF and WAPR-11	Standard Grilles	With WMICF	With WMICF and WAPR-11	Standard Features
J42HC	TBD	TBD	TBD	TBD	TBD	TBD	TBD
J48HC	TBD	TBD	TBD	TBD	TBD	TBD	TBD
J60HC	TBD	TBD	TBD	TBD	TBD	TBD	TBD

Integrated values calculated per ANSI/ASA S12.60-2009/Part 2, Section 5.2.2.1, Integrated Sound Vales are also applicable for use in learning spaces for LEED schools; EQ Prerequisite 3 - Minimum Acoustical Performance, OPTION 1. Using methods prescribed in ANSI S12.60, classroom must achieve a maximum background noise level of 45 dBA. Results Referenced Were Recorded In The Solair Manufacturing Company, Inc. Sound Lab Facility. Actual Field Application Results May Vary With Classroom Design and Construction Methods.

HEATER PACKAGES - FIELD INSTALLED W**HC SERIES UNITS

• Designed for adding Electric Heat to 0 KW Units			• ETL US & Canada Listed			
• Circuit Breaker Standard on 230/208V Models			• Toggle Disconnect Standard on 460V Models			
Air Conditioner Models	-A00 Models 230/208-1		-B00 Models 230/208-3		-C00 Models 460-3	
	Heater Model #	KW	Heater Model #	KW	Heater Model #	KW
J42HC	WMCB-07A	02	WMCB-05B	02	WMPD-01C	02
	EHWH04-A04B	04	TBD	06	TBD	06
	TBD	05	TBD	09	TBD	09
	TBD	10	TBD	15	TBD	15
	TBD	15				
J48HC	WMCB-08A	02	WMCB-05B	02	WMPD-01C	02
	EHWH04-A04B	04	TBD	06	EHW4TH-C09	09
	EHWH42-A05B	05	TBD	09	EHW4TH-C15	15
	EHW4TH-A10	10	TBD	15		
	EHWH42-A15B	15	TBD	18		
	EHWH04-A20B	20				
J60HC	WMCB-09A	02	WMCB-05B	02	WMPD-01C	02
	EHWH04-A05B	05	EHWH05-B09B	09	TBD	09
	EHW5TH-A10	10	EHWH05-B15B	15	TBD	15
	EHWH04-A15B	15	EHW4TH-B18	18		
	EHWH04-A20B	20				

////// **ELECTRIC HEAT TABLE - REFER TO ELECTRICAL SPECIFICATIONS FOR AVAILABILITY BY UNIT MODEL**

NOMINAL KW	AT 240V (1)				AT 208V (1)				AT 480V (2)			AT 460V (2)		
	KW	1-PH AMPS	3-PH AMPS	BTUH	KW	1-PH AMPS	3-PH AMPS	KW	KW	3-PH AMPS	KW	KW	3-PH AMPS	KW
4.0	4.0	16.7		13,652	3.00	14.4		10,239						
5.0	5.0	20.8		17,065	3.75	18.0		12,799						
6.0	6.0		14.4	20,478	4.50		12.5	15,359	6.0	7.2	20,478	5.52	6.9	18,840
8.0	8.0	33.3		27,304	6.00	28.8		20,478						
9.0	9.0		21.7	30,717	6.75		18.7	23,038	9.0	10.8	30,717	8.28	10.4	28,260
10.0	10.0	41.7		34,130	7.50	36.1		25,598						
15.0	15.0	62.5	36.1	51,195	11.25	54.1	31.2	38,396	15.0	18.0	51,195	13.80	17.3	47,099
18.0	18.0		43.3	61,434	13.50		37.5	46,076	18.0	21.7	61,434	16.56	20.8	56,519
20.0	20.0	83.3		68,260	15.00	72.1		51,195						

(1) These electric heaters are available in 230/208V units only.

(2) These electric heaters are available in 480V units only.

////// **WALL MOUNT™ VENTILATION OPTION SELECTION CHART**

VENT CODE	FIELD INSTALL KIT	UNIT	OPERATION	DESCRIPTION
X	FAD-NE5	J42HC, J48HC, J60HC, J72HC	Barometric	Air damper provides slight positive room pressure during blower operation, No room air exhaust.
Y	ECON-DB5	J42HC, J48HC, J60HC, J72HC	JADE Controller	Full flow Economizer that uses the JADE controller and included sensors to operate free cooling. Dry Bulb operation user selectable. No intake hood required.
Z	ECON-WD5	J42HC, J48HC, J60HC, J72HC	JADE Controller	Full flow Economizer that uses the JADE controller and included sensors to operate free cooling. Enthalpy operation user selectable. No intake hood required.

“X” Vent Code Option – Standard Fresh Air Damper No Exhaust (FAD-NE)

The barometric fresh air damper without exhaust is a standard feature on all models. It is installed on the right side above the condenser intake and allows outside ventilation air, up to 25% of the total airflow rating of the unit, to be introduced through the air inlet openings and to be mixed with the conditioned air. The damper opens during blower operation and closes when the blower is off. Adjustable blade stops allow different amounts of outside air to be introduced into the building and can be easily locked closed if required. The room exhaust air path is sealed with an insulated block-off plate.



Fresh Air Damper Intake (FAD-NE and FAD-BE)

“Y and Z” Vent Code Option – Economizers with JADE® Controller (ECON-WD and ECON-DB)

The JADE controlled economizer is internally mounted behind the service door and allows outside ventilation air. The ECON-WD allows up to 100% of the total airflow rating of the unit. It includes a built-in exhaust air damper for room pressurization relief. The economizer is designed to provide “free cooling” when outside air conditions are cool and dry enough to satisfy cooling requirements without running the compressor. This provides lower operating costs, extended equipment life, and cooling operation down to -40°F outdoor temperatures.



Economizer, Jade Control

“Y and Z” Vent Code Option – (ECON-WD) JADE® Controller Information

JADE Economizer controls provide Demand Ventilation Control, operational checkout, an easy to read LCD screen, configurable freeze protection, and LCD displayed economizer component failure alarms. Minimum vent position, occupancy ventilation, and 0-10V CO2 input is available for use with select CO2 room sensors. Economizer operation can be controlled by outdoor dry bulb or outdoor enthalpy measurement. When used with a Solair economizer assembly, the JADE controller is able to meet most state and local codes for economizer use.

JADE Controller Specifications:




- Operating Humidity Range (% RH) 5 to 95% RH, non-condensing
- Contact Ratings 30 VAC-- 1.5 A Run, 3.5 A Inrush
- Voltage 20 to 30 VAC RMS
- Operating Temperature Range (F) -40 F to +150 F
- Operating Temperature Range (C) -40 C to +65 C
- Approvals, Federal Communications Commission Compliant
- Approvals, CE Compliant
- Complies with California Title 24
- Mixed air and Outdoor Enthalpy Sensor using Sylk Bus.
- Output 2-10 VDC to actuator, Sylk Bus.



Jade Control Module




WALL MOUNT™ BAROMETRIC DAMPER (FAD) PERFORMANCE

“X” (FAD-NE5 and FAD-NE5) Barometric Damper Without Exhaust Vent Code Options

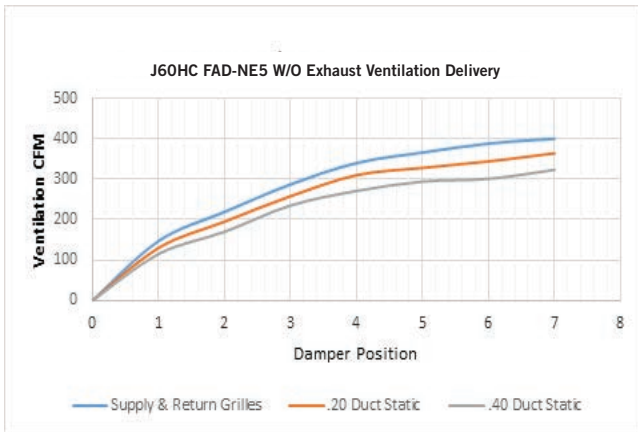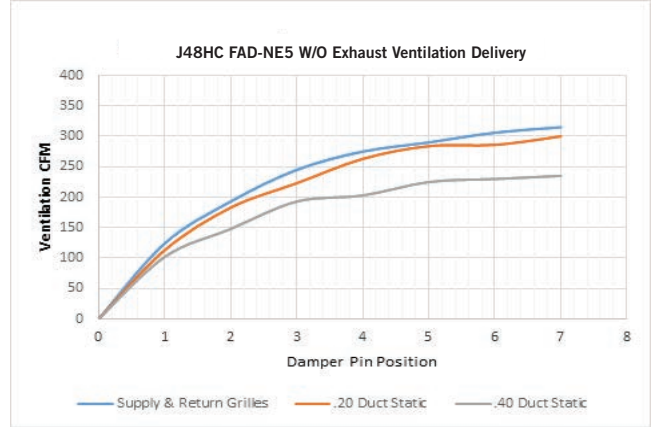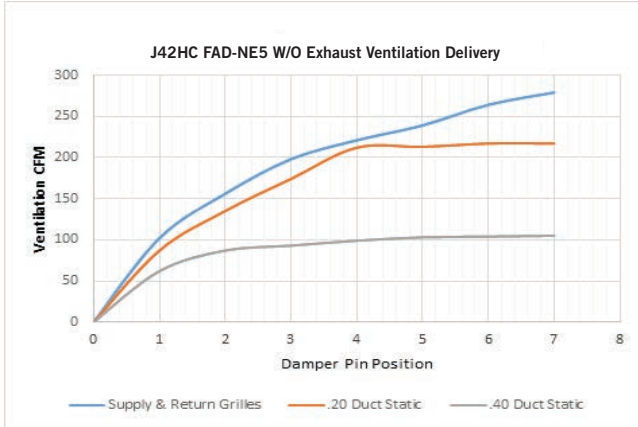

////// WALL MOUNT™ VENTILATION AIRFLOW CHARTS

“Y and Z” (ECON-WD and ECON-DB) Vent Code Options

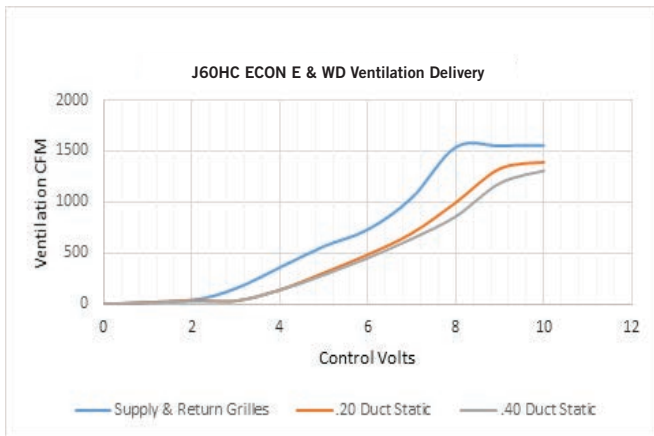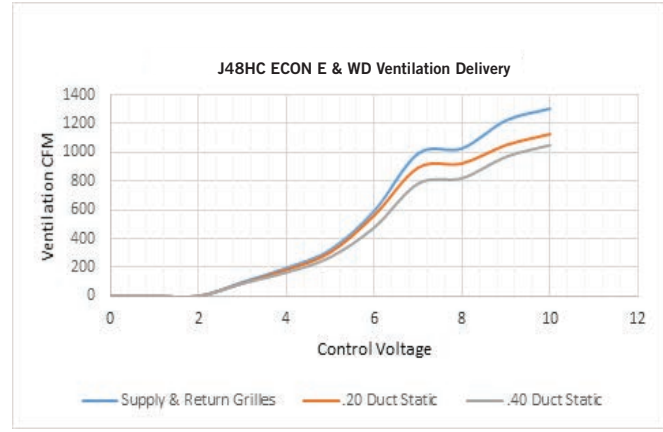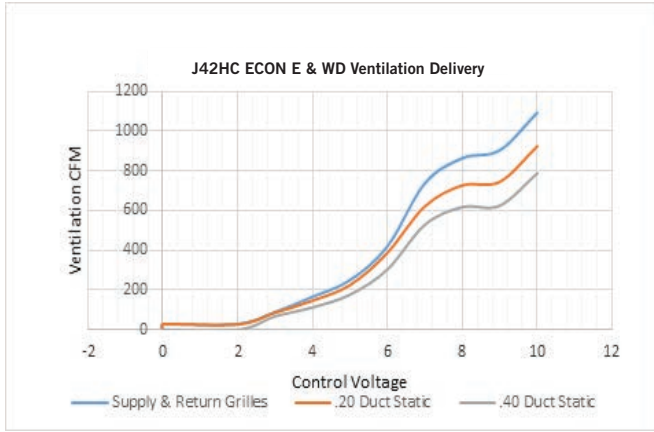

////// CABINET AND COIL OPTIONS

Cabinet Finish Options


Unit models are available in Beige. Painted cabinet construction is comprised of 20 gauge Zinc coated steel. Cabinet Panels are cleaned, rinsed, sealed, and dried before a polyurethane primer is applied. The cabinet coating is completed with a baked on textured enamel. The resulting finish is designed to withstand 1000 hours of salt spray tests per ASTM B117-03.



X—Beige

Green Fin Hydrophilic Evaporator Coils Standard On All Units

Solair WALL MOUNT products include a green protective coating applied to the aluminum fin stock used for the evaporator coil. The evaporator coil coating is hydrophilic (attracts water) and allows for proper condensate drainage along with mild corrosion protection. Resistance to corrosive agents include ammonia, sodium hydroxide, sodium chloride, acidic solutions and solvents.

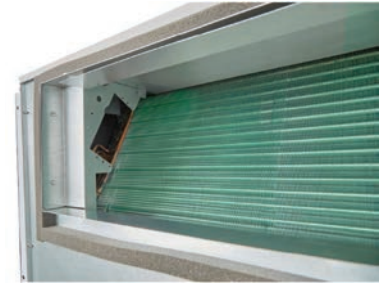

Hydrophilic Green Coil
(standard)

////// WALL MOUNT™ FACTORY INSTALLED CONTROLS OPTIONS

Factory installed controls are provided by Solair to enhance a WALL MOUNT product before it is shipped. All WALL MOUNT products are shipped with a auto-reset high pressure switch and an auto-reset low pressure switch to help protect refrigeration components. A compressor control module with adjustable voltage protection, delay on make and break, and high/low pressure diagnostics is also standard

CONTROL CODE	DESCRIPTION OF FACTORY INSTALLED COMPONENTS
X	Hi Pressure Switch, Low Pressure Switch, Compressor Control Module.
E	Hi Pressure Switch, Low Pressure Switch, Compressor Control Module, Low Ambient Control
F	Hi Pressure Switch, Low Pressure Switch, Compressor Control Module, Low Ambient Control, Dirty Filter Press. Switch
J	Hi Pressure Switch, Low Pressure Switch, Compressor Control Module, Low Ambient Control, Alarm Relay
Q	Hi Pressure Switch, Low Pressure Switch, Compressor Control Module, Outdoor Thermostat
R	Hi Pressure Switch, Low Pressure Switch, Compressor Control Module, Low Ambient Control, Outdoor Thermostat
S	Hi Pressure Control, Low Pressure Switch, Compressor Control Module, PTCR Start Kit
T	Hi Pressure Control, Low Pressure Switch, Compressor Control Module, Low Ambient Control, Outdoor Thermostat, PTCR Start Kit

////// WALL MOUNT™ FIELD INSTALLED KITS

Field installed kits provide accessories that can be installed in the field. Required components, wires, enclosures, screws, and instructions that are needed are provided within the kit.

CONTROL CODE	KIT PART NO.	UNITS USING KIT	DESCRIPTION OF FIELD INSTALLED KIT
E	TBD	TBD	Low Ambient Control allows compressor cooling between 0°F and 50°F outdoor temp. - fan cycling
E	TBD	TBD	Low Ambient Control allows compressor cooling between 0°F and 50°F outdoor temp. - modulating
E	TBD	TBD	Low Ambient Control allows compressor cooling between 0°F and 50°F outdoor temp. - modulating
NA	TBD	J42HC, J48HC, J60HC	PTCR Start Kit. Increases starting torque by 2 to 3x. 230V-60hz-1 phase (A voltage) only. Cannot be used in combination with SK start kit
NA	TBD	J42HC, J48HC, J60HC	Start Capacitor and Potential Relay Start Kit. Increases starting torque by 9x. 230V-60hz-1 phase (A voltage) only. Cannot be used in combination with CMC start kit
NA	TBD	J42HC, J48HC, J60HC	Outdoor Thermostat Kit used to disable compressor cooling below 50°F outdoor temp. Adjustable between 50° and 0°F
NA	TBD	J42HC, J48HC, J60HC	Dirty Filter Kit

////// 24VAC LOW VOLTAGE TERMINAL DESIGNATIONS

Solair WALL MOUNT products provide 24VAC power to controllers and thermostats. They also are able to receive 24VAC signals from a controlling device. The V controls option provides additional sensors for use with a field supplied DDC controls systems. The information below provides terminal designations and how they are used in the WALL MOUNT unit. More information on low voltage connections and operational sequences is provided in the unit installation manual.

Terminal	Unit	Description
R	All Units	24VAC low voltage output (HOT Terminal)
RT	All Units	RT terminal has jumper to R terminal. When jumper is removed, R and RT can be used with normally closed contacts for fire/smoke detector for unit shutdown.
C	All Units	Ground Terminal
G	All Units	Indoor fan input
Y1	All Units	1st Stage cooling input. Economizer stage when used. Balanced Climate stage when used.
Y2	All Units	2nd Stage cooling input. Compressor cooling stage when Econ or Balanced Climate is used.
B/W1	All Units	Reversing Valve (energize for heating)
B/W2	All Units	1st Stage electric heat
W3	All Units	2nd State electric heat. Jumper between W2 and W3 must be removed for staged heat
A	Vent option units only	Ventilation option input. Calls for occupied vent air intake for CRV, ERV, ECON
D	Dehum. units only	Dehumidification input on units equipped with mechanical reheat dehumidification
L	All Units	24VAC Alarm active output
1	J Control Opt.	Alarm relay Normally Closed Contract
2	J Control Opt.	Alarm relay Normally Open Contact
3	J Control Opt.	Alarm Relay Common Contact
11	F Control Option	Filter Switch, Normally Open Contacts
12	F Control Option	Filter Switch, Normally Open Contacts

OPTIONAL CONTROLS AND KIT COMPONENT DEFINITIONS

Hi Pressure Control (HPC) - The high pressure control provides a means of protecting the refrigeration circuit when high system pressures occur. It is a auto-reset device that is connected to the Compressor Control Module. When activated, the compressor is disabled until pressures reach an acceptable level. If activated twice in the same cooling call, compressor operation is locked out until the cooling call is interrupted.

Low Pressure Control (LPC) - The low pressure control provides a means of protecting the refrigeration circuit when extremely low system pressures occur. It is a auto-reset device that is connected to the Compressor Control Module. When activated, the compressor is disabled until pressures reach an acceptable level.

Heat Pump Control Board (HCB) - The heat pump control module locks out compressor operation to protect the refrigeration system based on signals from the hi and low pressure switches. It provides diagnostics to indicate when a refrigerant pressure event occurs through a LED light. Defrost operation is controlled by the board, and defrost timing is adjustable. A 10k defrost sensor is connected to the condenser coil to sense coil freeze conditions. The Control board energizes a 3-way reversing valve to activate compressor heating operation when the "B" 24VAC terminal is energized on the low voltage terminal block.

Alarm Relay (ALR) - The alarm relay provides a set of NO and NC pilot duty contacts that operate when the heat pump control board locks out compressor operation because of a high or low system refrigerant pressure event.

Low Ambient Control (LAC) - The low ambient control pressure sensor is attached to the suction line of the system, and monitors low side system pressure. Operation of the LAC occurs as outdoor temperatures drop below the 65°F. On/Off and modulating controls are used. On/Off LAC operation cycles the condenser fan operation based on outdoor temperature. Modulating LAC operation is factory adjusted and slows the condenser fan speed RPM based on outdoor temperature.

Crankcase Heater (CCH) - The heater is a belly band that is installed around the base of the compressor that applies heat when the refrigeration system is not operational. This heat is meant to prevent refrigerant oil migration when the unit is not running. Normal scroll compressor use does not require the use of the CCH, and this option is only recommended for northern areas of the US and Canada with extreme cold operation. Field Install Option Only.

Outdoor Thermostat (ODT) - The outdoor thermostat measures outdoor temperatures and includes relay contacts (NO). The relay is located on the outer control panel and the sensor bulb is mounted to the fan shroud in the outdoor condenser section. When wired into the cooling signal inside the control panel, compressor operation can be disabled when temperatures are below the adjustable setting. Adjustment range is 0°F to 50°F.

PTCR Start Kit - PTCR (Precision Temperature Coefficient Resistor) start kit includes the start device and wires needed for installation. The device is located inside the unit control panel near the compressor capacitor and provides an increase in starting torque. The PTCR Start Kit is not normally required when a clean, stable power source is available for the unit. The kit can only be used in 230 Volt single phase units.

Start Capacitor and Potential Relay Start Kit - The kit includes a start capacitor and relay that is energized during startup of the compressor. The capacitor, relay, and needed wires are provided in a metal enclosure that is field installed in the outdoor section attached to the back. The Start Capacitor Kit is not normally required when a clean, stable power source is available for the unit. The kit can only be used in 230 Volt single phase units. Start capacitor kit cannot be used with the PTCR start kit installed.

Dirty Filter Switch Indicator (DFS) - The switch is adjustable and measures pressure drop across the unit filter surface. When pressure drop is higher than the switch setting NO and NC contacts are provided to indicate the filter needs to be serviced.

////// CABINET AND CLEARANCE DIMENSIONS - W**HC SERIES UNITS

CLEARANCES REQUIRED FOR SERVICE ACCESS AND ADEQUATE CONDENSER INLET AIRFLOW

MODELS	LEFT SIDE	RIGHT SIDE
J42HC, J48HC, J60HC	20"	20"

- 1.) Follow all national, state, and local codes and regulations regarding the installation of heating and cooling equipment regarding Single Packaged Vertical Units (SPVU) including electrical access clearances.
- 2.) Field ventilation installation with the unit installed requires 40" on the left or right side of the unit.
- 3.) Solair recommends a minimum of 10 ft. between the unit front condenser air outlet and solid objects including fences, walls, bushes, and other airflow obstructions.
- 4.) Solair recommends a minimum of 15 ft. between the condenser air outlets of 2 units that are facing each other.
- 5.) Solair recommends a minimum clearance of 4" under the unit cabinet for condenser defrost drain age during heat pump operation.

MINIMUM CLEARANCES REQUIRED TO COMBUSTIBLE MATERIALS


MODELS ①	SUPPLY AIR DUCT FIRST THREE FEET	CABINET
J42HC, J48HC, J60HC	1/4"	0"

① Refer to the Installation Manual for more detailed information.

DIMENSIONS OF W42AC-W72AC BASIC UNIT FOR ARCHITECTURAL & INSTALLATION REQUIREMENTS (NOMINAL)

MODEL	WIDTH (W)	DEPTH (D)	HEIGHT (H)	SUPPLY		RETURN															
				A	B	C	B	D	E	F	G	I	J	K	L	M	N	O	R	S	T
J42HC J48HC	42	25.52	84.75	9.88	29.88	15.88	29.88	25.52	43.88	12.63	39.06	30.06	53.75	26.94	55.59	52.59	8.82	43	1.438	16	1.88
J60HC	42	25.52	92.88	9.88	29.88	15.88	29.88	25.52	43.88	12.63	45	30.06	59.75	35.06	61.72	58.72	8.82	43	1.438	16	10.00

① Wall Mounting holes in side flanges are 0.375.

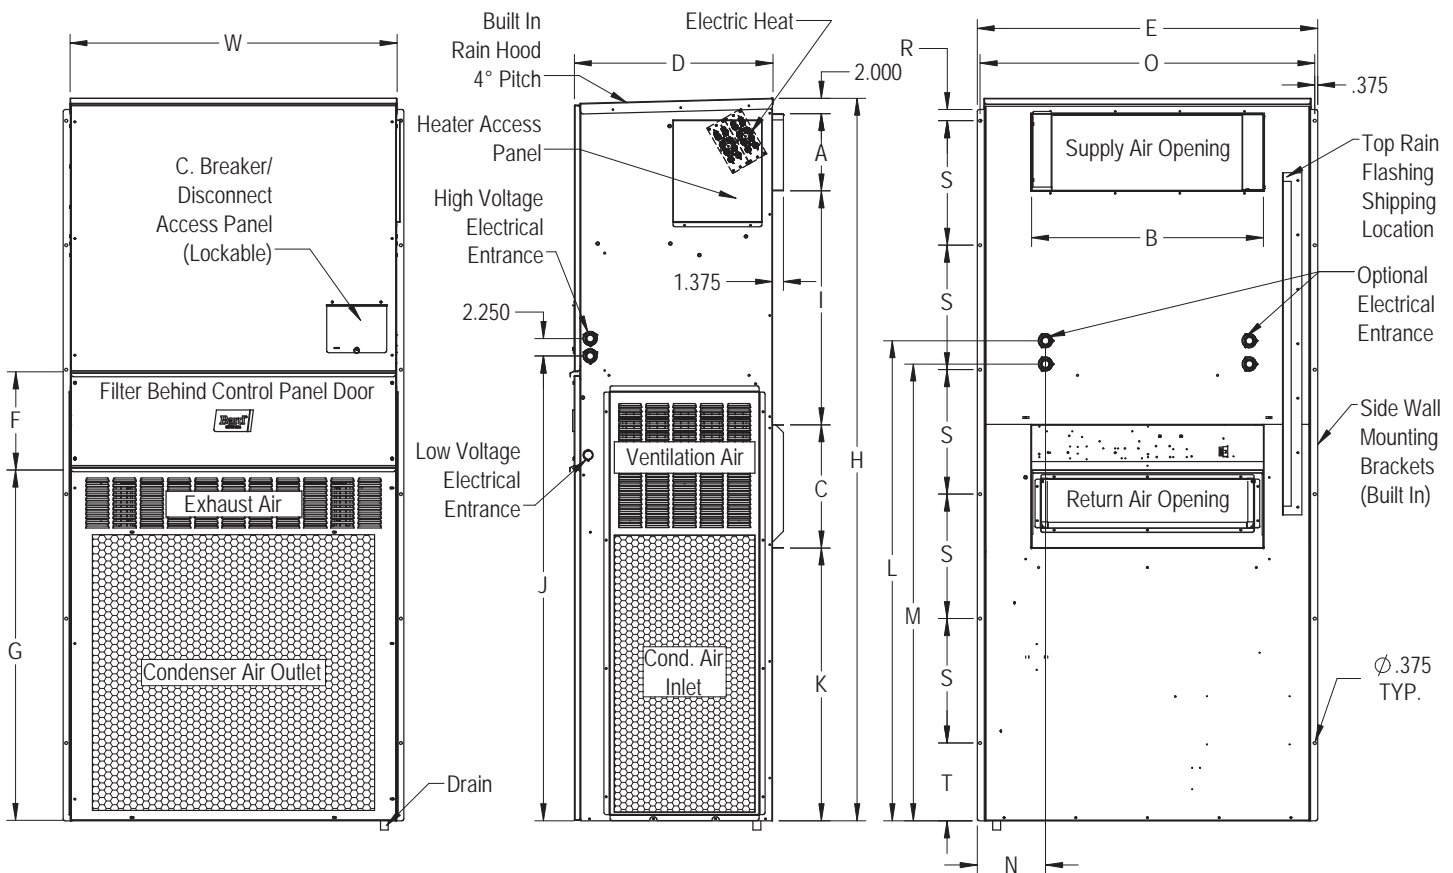

MIS-3978

////// WALL CURB ACCESSORIES

Optional wall curb accessories are available to help reduce vibration through the outer wall surface or to use existing wall openings when replacing equipment. Follow all static pressure airflow requirements, safety and installation guidelines in the instructions provided with the curb and WALL MOUNT products.

CURB	UNITS USING CURB	DESCRIPTION
WMCF5 *	J42HC, J48HC, J60HC	Provides vibration isolation for reduced sound transmission through wall
WWC5 *	J42HC, J48HC, J60HC	Install to use with existing wall openings. Wall openings must provide sufficient airflow

* Color Option

////// INDOOR SOUND REDUCTION ACCESSORIES

Optional sound accessories are available to help reduce sound transmission from the supply and return openings inside the indoor area. Follow all static pressure airflow requirements, safety and installation guidelines in the instructions provided with the accessories and WALL MOUNT products.

ACCESSORY	UNITS USING ACCESS.	DESCRIPTION
WAPR11 *	J42HC, J48HC, J60HC	Acoustical return air plenum that offsets the return air path. Air intake at floor level

* Color Option

////// NON-DUCTED SUPPLY AND RETURN GRILLES

Supply and return louver grilles are of a brushed aluminum finish. 2" flange versions are recommended for standard installations to allow grille attachment when large wall openings are present. Return filter grilles are available for filter access from an indoor area. Filter grilles do not include a filter, and are not recommended for unit with ventilation due to filter location. A manual damper return grille is available for W30 and W36 models. The manual damper is adjustable, and is only recommended for installations where increased return duct static pressure is required.

GRILLE NO.	UNITS USING GRILLE	DESCRIPTION OF LOUVER GRILLE
SG-5W	J42HC, J48HC, J60HC	10" x 30" with 2" Flange 4 way deflection supply grille. Use for standard installations
RG-5W	J42HC, J48HC, J60HC	16" x 30" with 2" Flange return grille. Use for standard installations.
RFG-5W	J42HC, J48HC, J60HC	16" x 30" with 2" Flange return grille with filter bracket.
RGD-5	J42HC, J48HC, J60HC	16" x 30" with 1" Flange return grille. Manual damper used to restrict return air

////// NON-DUCTED SUPPLY GRILLES - SPREAD AND THROW CHARACTERISTICS

One of the most important setup procedures for non-ducted supply applications is to adjust the 4 way supply grille blade positions. Placement of equipment, occupants, the thermostat, and room size can all play an important role in deciding how the conditioned supply air must be directed in an indoor area. The chart below may be used as a reference tool to help with this process.

SUPPLY GRILLE	AIRFLOW CFM	DEFLECTION	VELOCITY	TOTAL PRESSURE	THROW
SG-5W	1450 CFM	0°	968	.073" WC	51-73 ft.
		22.5°	1071	.103" WC	39-56 ft.
		45°	1331	.169" WC	28-40 ft.
	2000 CFM	0°	1336	.130" WC	61-86 ft.
		22.5°	1477	.188" WC	54-65 ft.
		45°	1835	.335" WC	33-46 ft.

////// CONTROLLER, THERMOSTAT, HUMIDISTAT AND CO2 VENTILATION CONTROL OPTIONS

Solair provides a wide variety of controllers for equipment cooling, thermostats, for equipment and comfort cooling, humidistats for dehumidification units, and CO2 sensors for ventilation control. Lockable thermostat covers are available for applications where security or supervisory control is desired.

CONTROLLER	OPERATION	DESCRIPTION
MC-4002	2 Unit Lead/Lag Controller	Standard Lead/Lag Controller with remote alarming capability.

THERMOSTAT	OPERATION	DESCRIPTION
8403-057	1 Heat/1 Cool	Easy to use, Nonprogrammable
8403-059	2 Heat/2 Cool	Programmable or Nonprogrammable
8403-060	3 Heat/3 Cool	Programmable or Nonprogrammable, ventilation output, dehumidification operation
8403-089	1 Heat/1 Cool	Temp. Settings per Day 4, 2, 1, 0 Programs per Week 7, 5-2, 5-1-1 or Nonprogrammable
8403-090	2 Heat/2 Cool	Temp. Settings per Day 4, 2, 1, 0 Programs per Week 7, 5-2, 5-1-1 or Nonprogrammable
8403-091	1 Heat/1 Cool	Easy to use, Nonprogrammable. FEMA use
8403-092	2 Heat/2 Cool	Programmable or Nonprogrammable, ventilation output, Wi-Fi

HUMIDISTAT	OPERATION	DESCRIPTION
8403-038	Humidity %RH	Easy to use w/SPDT switching. Ratings: Pilot duty 50VA @24V, 120VA @ 120/240V
8403-047	Humidity %RH	Electronic with display, EEPROM memory, lockable keypad, humidity sensor calibration

CO2 CONTROL	OPERATION	DESCRIPTION
S8403-067	CO2 PPM	CO2 ventilation control with digital display. On/Off or modulating ventilation operation

THERMOSTAT COVER*	SIZE	DESCRIPTION
8405-003	(Inside) 5-1/16" H x 6-1/16" W (Outside) 6-1/2" H x 7-1/2" W x 2-15/16" D	Clear acrylic with ventilation. Fits all thermostats except 8403-060
8405-005	(Inside) 5-7/8" H x 8-3/8" W (Outside) 7-1/4" H x 9-3/4" W x 3-3/8" D	Clear acrylic with ventilation. Fits all thermostats.
8405-006	(Inside) 5-1/16" H x 6-1/16" W (Outside) 6-3/8" H x 7-3/8" W x 2-7/8" D	Clear acrylic with ventilation. Fits all thermostats except 8403-060
8405-007	(Inside) 5-7/8" H x 8-3/8" W (Outside) 7-1/8" H x 9-5/8" W x 3-1/4" D	Beige painted steel cover with ventilation. Fits all thermostats.

* Thermostat covers include ventilation, but may effect temperature control reaction time. If security control lockout is needed, the 8403-060 thermostat provides input control lockout features.

Due to our continuous product improvement policy, all specifications subject to change without notice.

Before purchasing this appliance, read important energy cost and efficiency information available from your retailer.